


Atrazine Setback Requirement Illustration

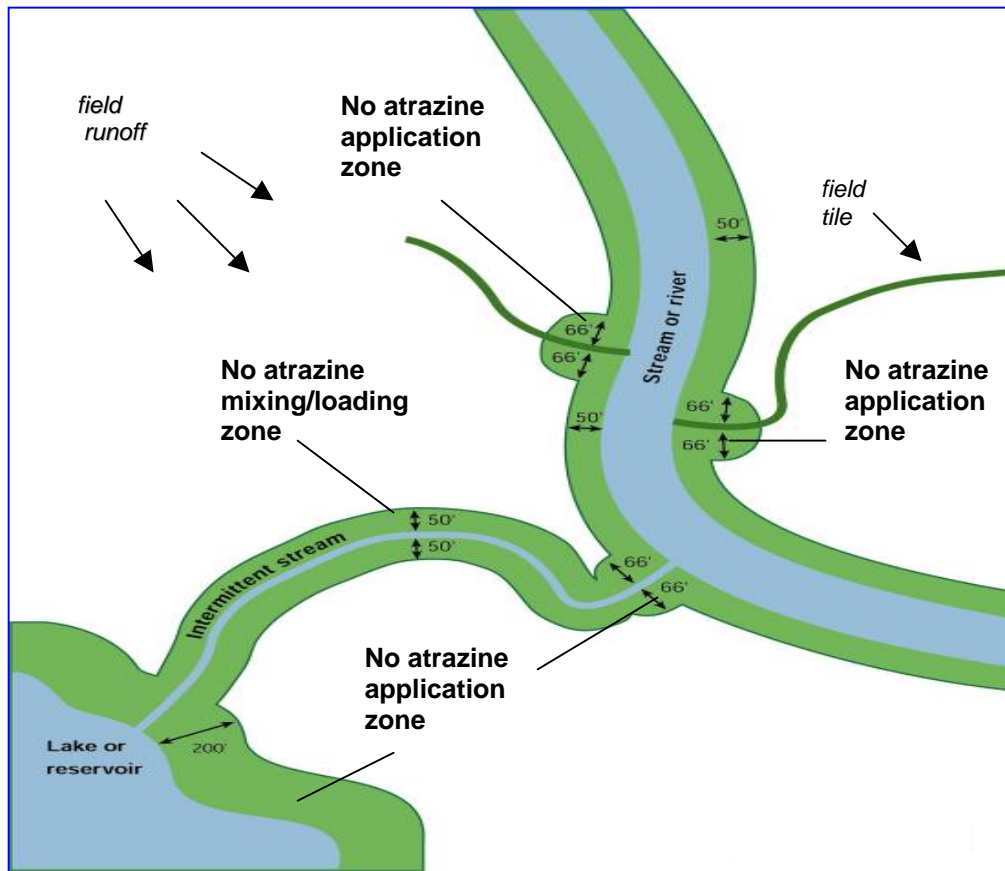

Products that contain atrazine cannot be:

- Mixed or loaded within 50 feet of intermittent streams, rivers, natural or impounded lakes or reservoirs.
- Applied (aerial or ground) within 66 feet of the points where field runoff (surface water) enters perennial or intermittent streams or rivers. The 66-foot setback must be planted to the crop or seeded with another suitable crop if the land is "highly erodible."
- Applied within 200 feet of natural or impounded lakes or reservoirs.
- Mixed, loaded or applied within 50 feet of any well, including abandon wells, drainage wells and sinkholes (no illustration).
- Applied within 66 feet of a tile inlet, if the tile inlet or riser drains into a perennial or intermittent stream or river within 66 feet. The 66-foot tile inlet setback is not required if atrazine is incorporated and/or greater than 30% residue is present.

References:

"Atrazine Label Revisions for 1993," Office of Indiana State Chemist Memorandum, January 22, 1993.

"USGS Topographic Map Symbols," <http://erg.usgs.gov/isb/pubs/booklets/symbols/>

"Atrazine Use and Weed Management Strategies to Protect Water Quality," PPP – 67
Purdue Pesticide Programs <http://www.btny.purdue.edu/pubs/ppp/ppp-67.pdf>

"Atrazine Management and Water Quality," Missouri Manual –167
<http://muextension.missouri.edu/explorepdf/miscpubs/M00167.pdf>